


3. AS A GENERAL GUIDE, THE MINIMUM CLEARANCE REQUIRED FROM ANY OBSTRUCTION IS: 6 FEET ON INLET END, 3 FEET ON SIDES AND 8 FEET ON EXHAUST END. REVIEW MANUAL FOR DETAILED INSTALLATION AND SITE CONDITIONS.

2. ALL DIMENSIONS ARE APPROX.

1. WEIGHT: APPROX 1800 LBS



NOTES:

FOR APPLICATION ENGINEERING USAGE ONLY

					DRAWN FLAUTO		DATE 1-17-97		DRAWING NUMBER
					CHECKED FLAUTO		DATE 1-17-97		SB2657
					APPROVED D.KOZAR		SCALE 1/16		SHT 1 OF 2
					MODEL K575A				OUTLINE DRAWING

CA551	C	REV'D PER ECN	ZMECEK	3/17/98	KOZAR
CA270	B	REV'D PER ECN	MARTIN	6/25/97	MITCHELL
AD995	A	REV'D NOTE 3	FACKELMANN	3/7/97	J. EMERY
ECN NO.	REV LET.	CHANGE	CHG'D	CHK'D	

LOAD BANK (OUTDOOR)	
---------------------	--

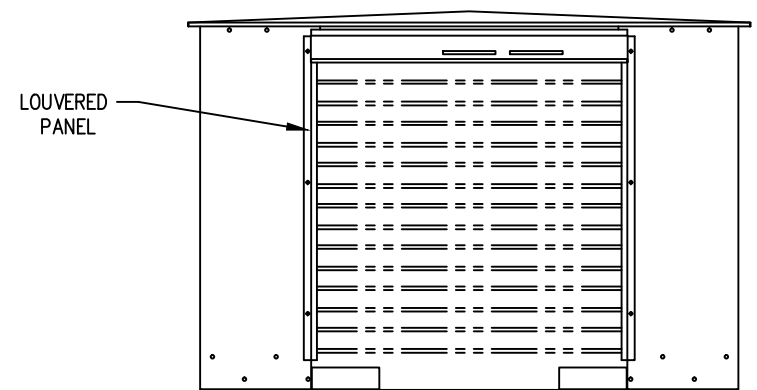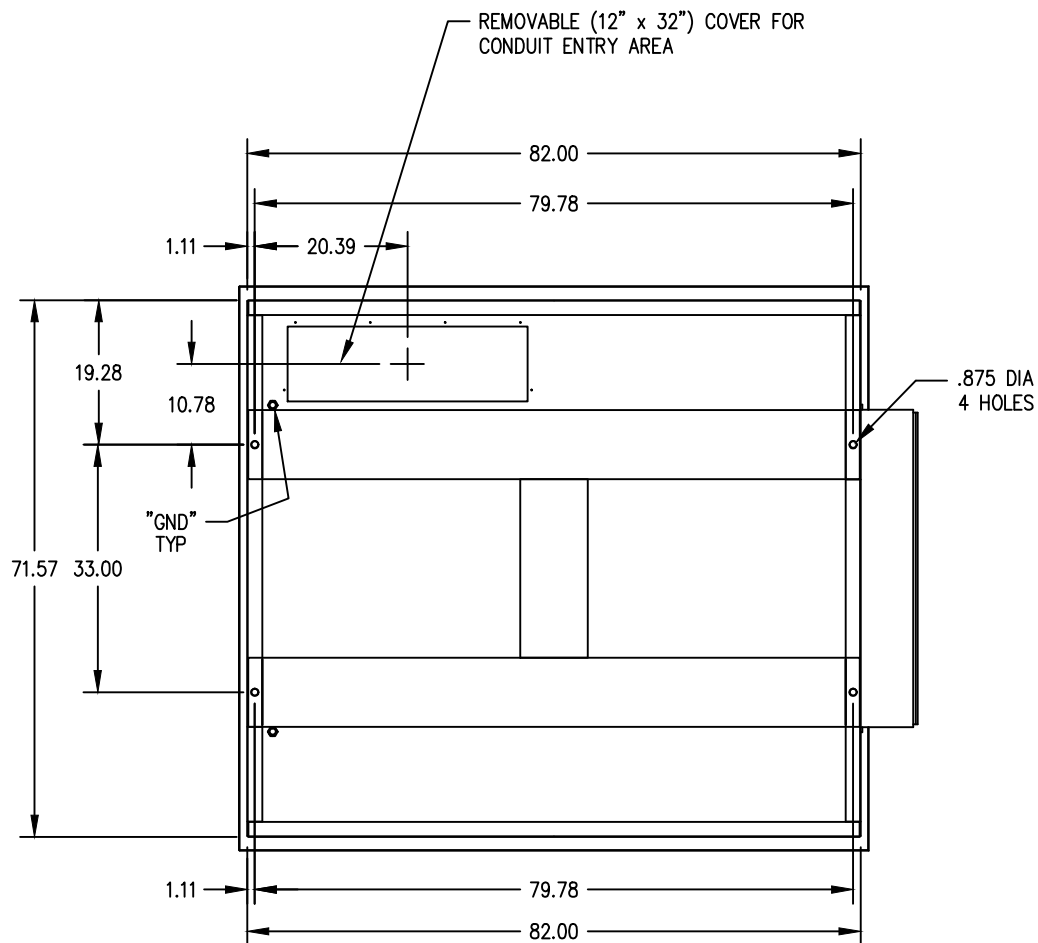


VIEW B-B

VIEW A-A
(BOTTOM VIEW)

FOR APPLICATION ENGINEERING USAGE ONLY

2. ALL DIMENSIONS ARE APPROX.
1. WEIGHT:
NOTES:

						DRAWN		FLAUTO	DATE	1-17-97	 <div>MANUFACTURING, INC. INDEPENDENCE, OH</div>	DRAWING NUMBER
CA551	C	REV'D PER ECN	ZMECEK	3/17/98	KOZAR	CHECKED		FLAUTO	DATE	1-17-97		SB2657
CA270	B	REV'D PER ECN	MARTIN	6/25/97	MITCHELL	APPROVED		D.KOZAR	SCALE	1/16		SHT 2 OF 2
AD995	A	NO CHANGE THIS SHEET		FACKELMANN	3/7/97	J. EMERY	LOAD BANK (OUTDOOR)					OUTLINE DRAWING
ECN NO.	REV LET.	CHANGE		CHG'D	CHK'D	MODEL K575A						

AVTRON MANUFACTURING, INC.
INDEPENDENCE, OH

LOAD BANK (OUTDOOR)